




quick guide xcom 485i-nx

communication module for nx
system with vario solar charger

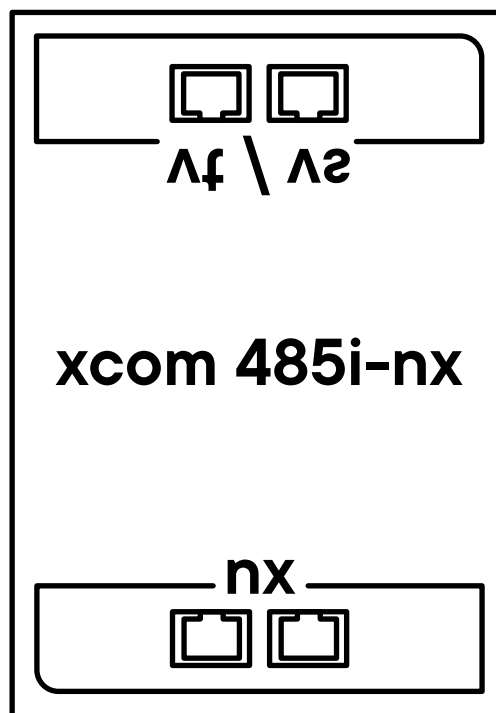


Connexion/Connection/Anschluss/Connessione


vt / vs

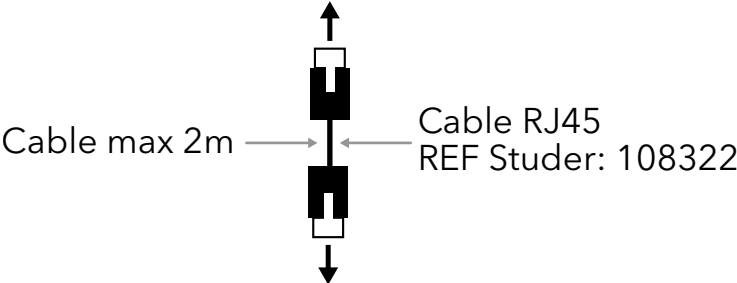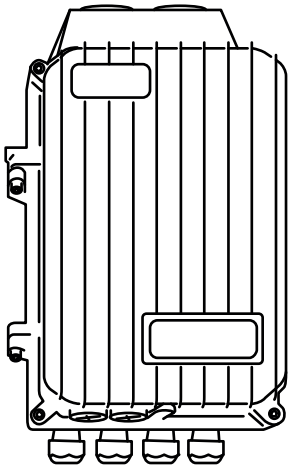

Cable max 2m Cable RJ45
REF Studer: 108322

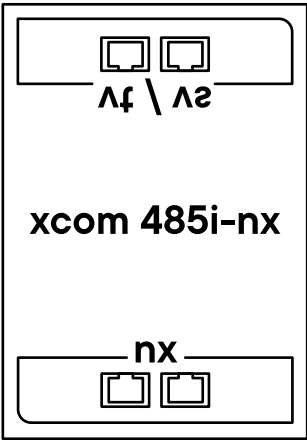


Cable RJ45 xcom 485i to nx series
REF Studer: 119014
Cable max 3m

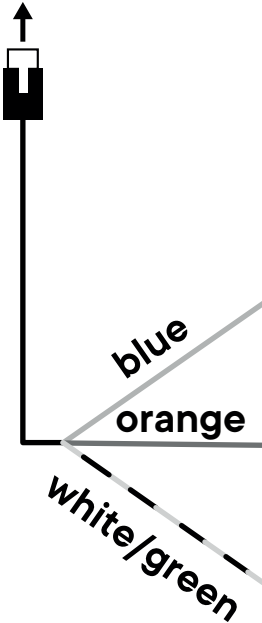

Inverter

nx1	nx3	rj45 pin
GND	GND	4
RS-RX or D -	D -	2
RS-TX or D +	D +	3

Terminations/Terminaisons/Terminierung/Terminazione

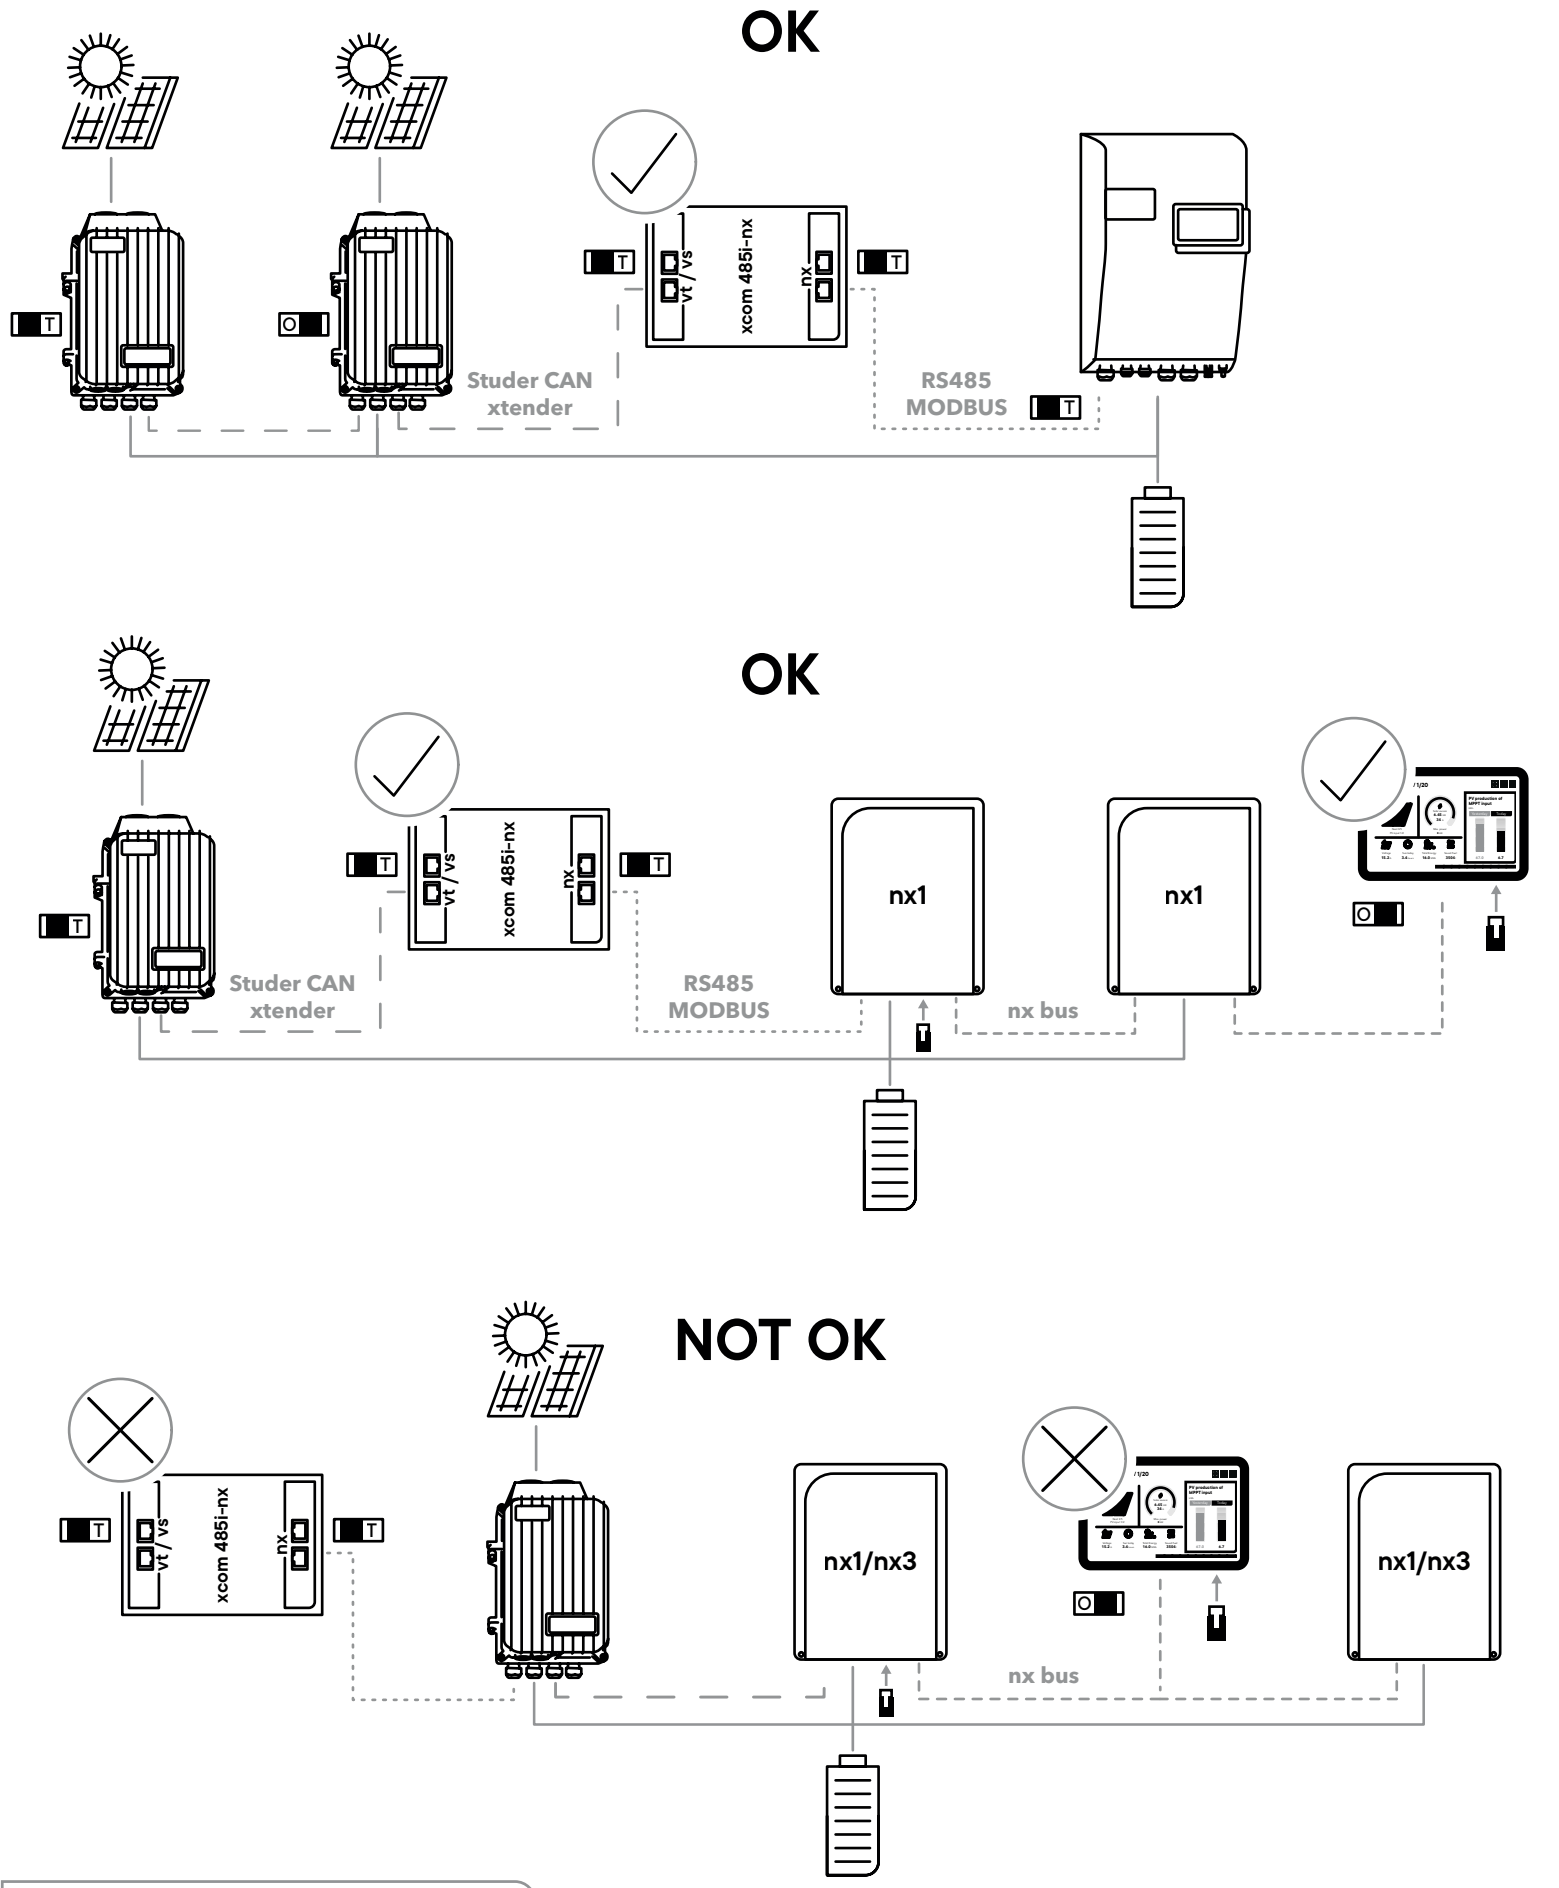

EN Impedance for chain termination.
FR Impédance pour la terminaison de la chaîne.
DE Impedanz für Kettenabschluss.
IT Impedenza di terminazione della catena.

Troubleshooting

1

EN variostring software version $\geq 1.6.34$
 variotrack software version $\geq 1.6.58$
 Update process in the user manual of
 xcom 485i, you will need an rcc02/03.

DE variostring-Softwareversion $\geq 1.6.34$
 variotrack-Softwareversion $\geq 1.6.58$
 siehe Update-Prozess im Benutzerhandbuch
 des xcom 485i; Sie benötigen ein rcc02/03.

FR Version du logiciel variostring $\geq 1.6.34$
 Version du logiciel variotrack $\geq 1.6.58$
 Voir le processus de mise à jour dans le manuel
 xcom 485i ; vous aurez besoin d'un rcc02/03.

IT Versione del software variostring $\geq 1.6.34$
 Versione del software variotrack $\geq 1.6.58$
 Procedura di aggiornamento descritta nel manuale
 d'uso di xcom 485i; è necessario un rcc02/03.




2

EN Checking jumpers and DIP switches.

FR Verification des jumpers et dipswitch.

DE Überprüfung der Jumper und DIP-Schalter.


IT Verifica dei ponticelli e dei DIP switch.

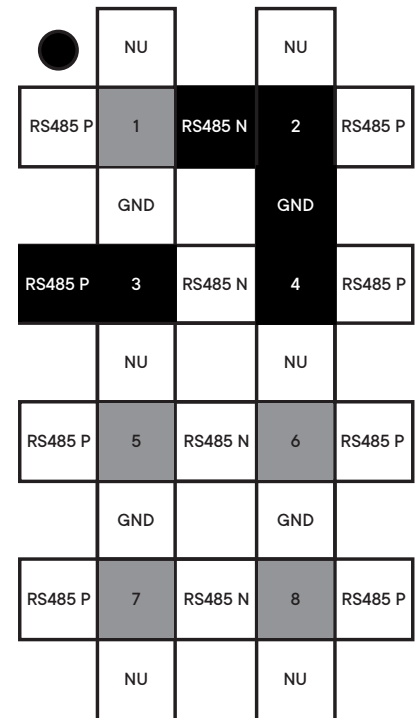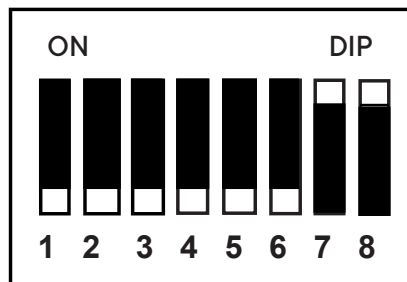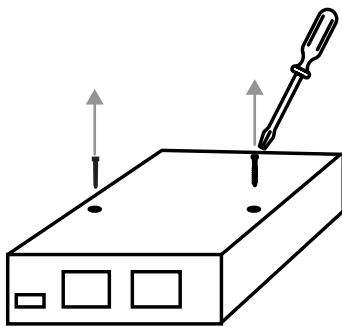

LED states

green 2x - running without any error

orange 1x - starting up

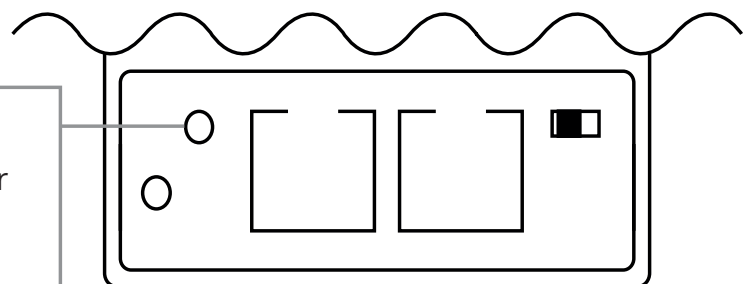

Studer Innotec SA
 Rue des Casernes 57
 1950 Sion, Switzerland

Call our specialists +41 27 205 60 80
 or visit studer-innotec.com/support
info@studer-innotec.com

© All rights reserved
 Studer Innotec SA - V2.0
 Data may change without any notice

